




Tester:	Jinglan Zeng			Date:	11/Sep/2023
1	Item number			62/1720/EM	
2	Power source			3pcs IFR18650 2000mAh 3.2V	
3	Input frequency			NA	
4	Power supply properties			Emergency Power Supply	
5	Lux meter			EVERFINE Z-10	
6	Number of samples			1pc	
7	Voltage of full charged batteries without load			11.2V	
				Equipment Model	Illuminance Meter
					EVERFINE Z-10
Time(min)	2700K Lux *200cm, **60cm	% of Lux	***Lux 200cm Center		Remark
Battery ON	25.7				Charge for 24 H, the green light is on, 100% complete charge, collect the luminance value corresponding to the color temperature at different points in time. *Light cone height 200cm **Radius of the base of the light cone 30cm ***Center of the base of the light cone
0	25.7	100.0%	90.3		
15	11.3	44.0%	39.5		
20	11.3	44.0%	39.7		
30	6.6	25.7%	23.1		
40	6.6	25.7%	23.1		
50	6.5	25.3%	23.1		
60	3.4	13.2%	12.1		
70	3.4	13.2%	12.1		
80	3.4	13.2%	12.1		
90	3.4	13.2%	12.1		
317	0.0	0.0%	0.0		
317	Light off				
Tester: Jinglan Zeng Chen		Auditor: Jinglan Zeng			
Trend:					

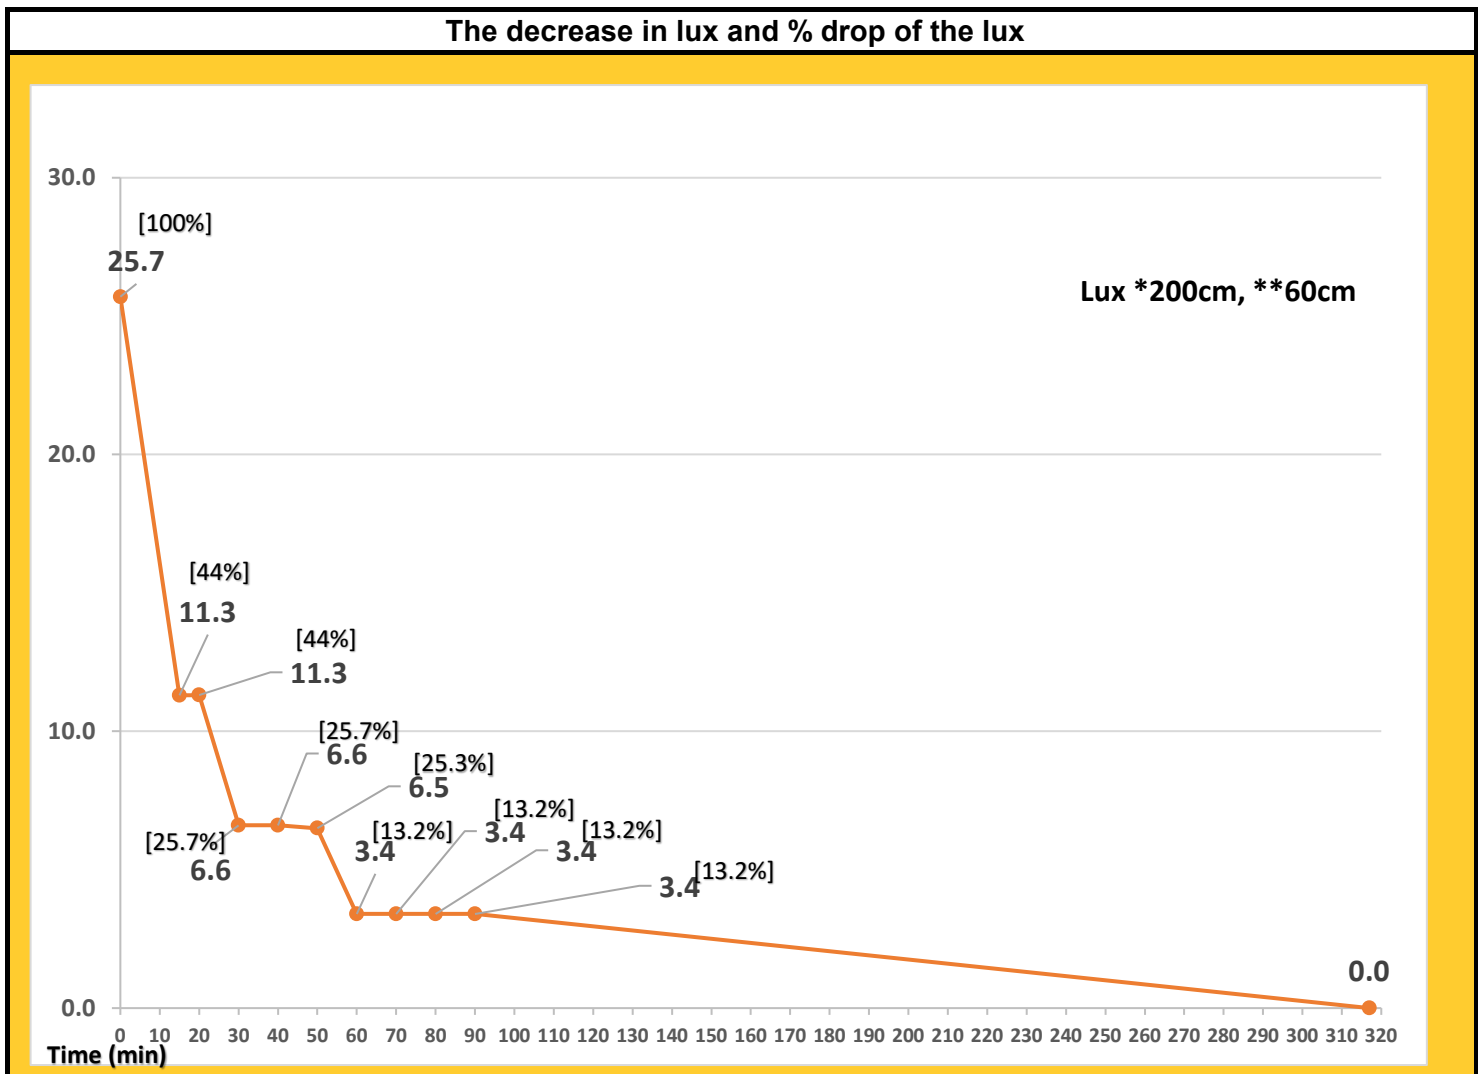


Tester:	Jinglan Zeng			Date:	11/Sep/2023
1	Item number			62/1720/EM	
2	Power source			3pcs IFR18650 2000mAh 3.2V	
3	Input frequency			NA	
4	Power supply properties			Emergency Power Supply	
5	Lux meter			EVERFINE Z-10	
6	Number of samples			1pc	
7	Voltage of full charged batteries without load			11.2V	
				Equipment Model	Illuminance Meter
					EVERFINE Z-10
Time(min)	3000K Lux *200cm, **60cm	% of Lux	***Lux 200cm Center		Remark
Battery ON	26.1				Charge for 24 H, the green light is on, 100% complete charge, collect the luminance value corresponding to the color temperature at different points in time. *Light cone height 200cm **Radius of the base of the light cone 30cm ***Center of the base of the light cone
0	26.1	100.0%	91.6		
10	11.4	43.7%	39.8		
20	11.4	43.7%	40.1		
30	6.7	25.7%	23.3		
40	6.7	25.7%	23.4		
50	6.6	25.3%	23.4		
60	3.5	13.4%	12.2		
70	3.5	13.4%	12.2		
80	3.5	13.4%	12.2		
90	3.5	13.4%	12.2		
317	0.0	0.0%	0.0		
317	Light off				
Tester: Jinglan Zeng Chen		Auditor: Jinglan Zeng			Approved by: Shunyang
Trend:					

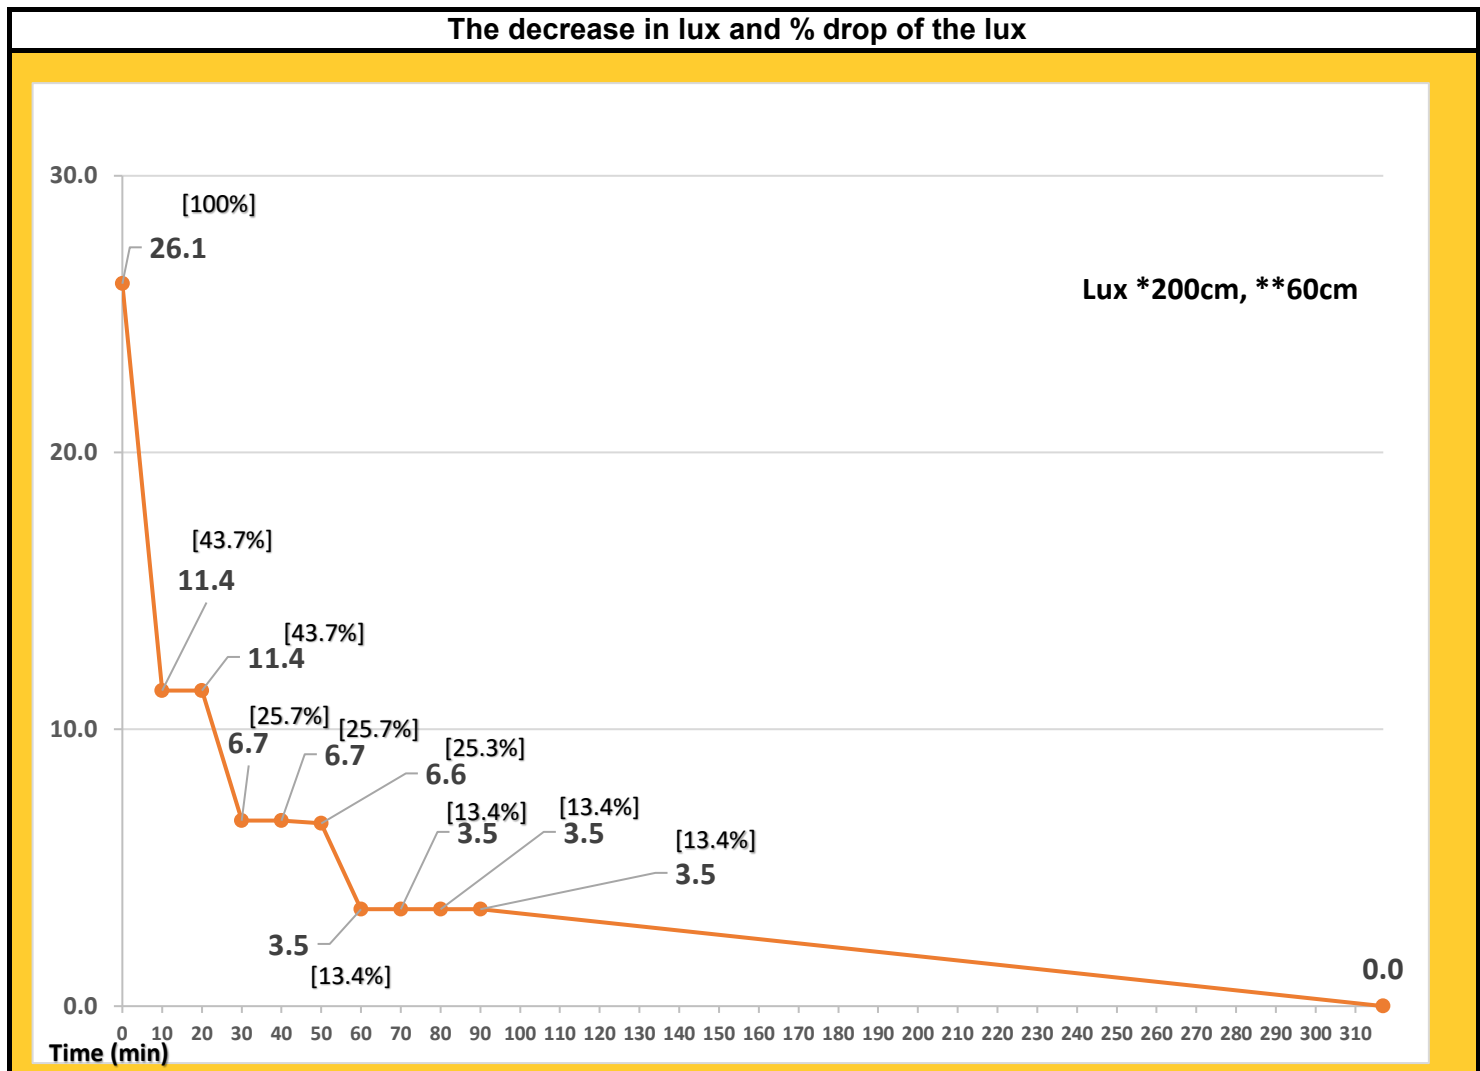

Tester:	Jinglan Zeng			Date:	11/Sep/2023
1	Item number			62/1720/EM	
2	Power source			3pcs IFR18650 2000mAh 3.2V	
3	Input frequency			NA	
4	Power supply properties			Emergency Power Supply	
5	Lux meter			EVERFINE Z-10	
6	Number of samples			1pc	
7	Voltage of full charged batteries without load			11.2V	
				Equipment Model	Illuminance Meter
					EVERFINE Z-10
Time(min)	3500K Lux *200cm, **60cm	% of Lux	***Lux 200cm Center		Remark
Battery ON	26.2				Charge for 24 H, the green light is on, 100% complete charge, collect the luminance value corresponding to the color temperature at different points in time. *Light cone height 200cm **Radius of the base of the light cone 30cm ***Center of the base of the light cone
0	26.2	100.0%	91.7		
15	11.5	43.9%	40.2		
20	11.5	43.9%	40.4		
30	6.7	25.6%	23.5		
40	6.7	25.6%	23.6		
50	6.7	25.6%	23.6		
60	3.5	13.4%	12.3		
70	3.5	13.4%	12.4		
80	3.5	13.4%	12.4		
90	3.5	13.4%	12.4		
317	0.0	0.0%	0.0		
317	Light off				
Tester: Jinglan Zeng		Auditor: Jinglan Zeng		Approved by: Shunyang	
Chen					
Trend:					

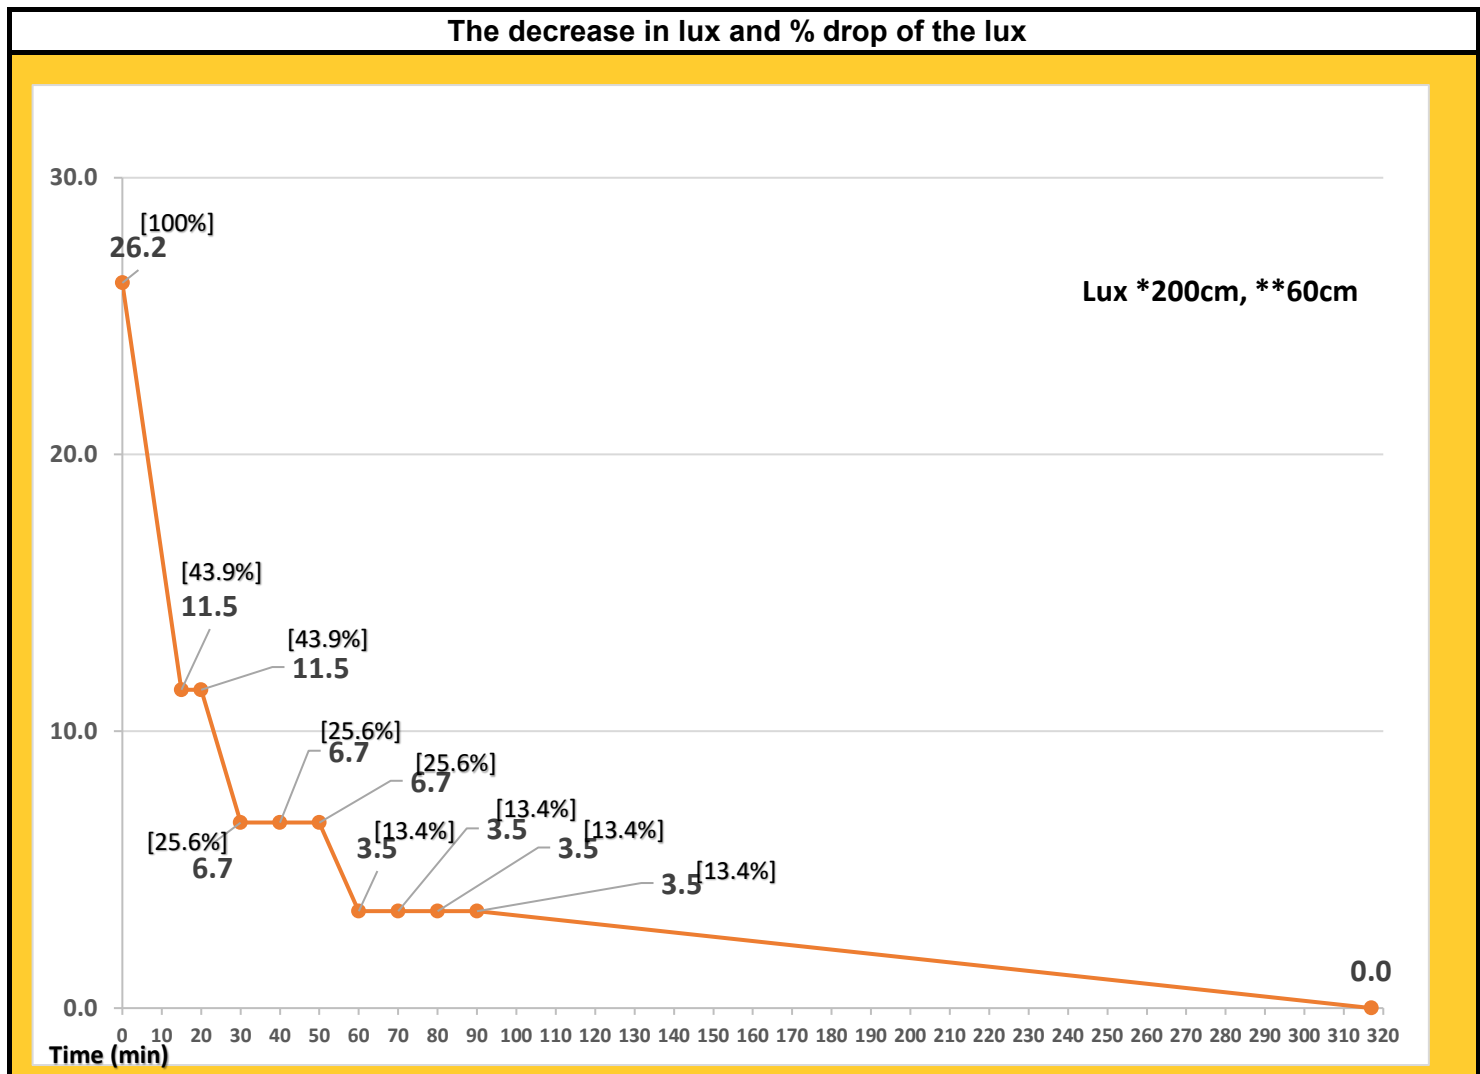

Tester:	Jinglan Zeng			Date:	11/Sep/2023
1	Item number			62/1720/EM	
2	Power source			3pcs IFR18650 2000mAh 3.2V	
3	Input frequency			NA	
4	Power supply properties			Emergency Power Supply	
5	Lux meter			EVERFINE Z-10	
6	Number of samples			1pc	
7	Voltage of full charged batteries without load			11.2V	
				Equipment Model	Illuminance Meter
					EVERFINE Z-10
Time(min)	4000K Lux *200cm, **60cm	% of Lux	***Lux 200cm Center		Remark
Battery ON	26.3				Charge for 24 H, the green light is on, 100% complete charge, collect the luminance value corresponding to the color temperature at different points in time. *Light cone height 200cm **Radius of the base of the light cone 30cm ***Center of the base of the light cone
0	26.3	100.0%	92.2		
10	11.6	44.1%	39.8		
20	11.6	44.1%	40.1		
30	6.8	25.9%	23.3		
40	6.8	25.9%	23.4		
50	6.8	25.9%	23.4		
60	3.6	13.7%	12.2		
70	3.6	13.7%	12.2		
80	3.6	13.7%	12.2		
90	3.6	13.7%	12.2		
317	0.0	0.0%	0.0		
317	Light off				
Tester: Jinglan Zeng		Auditor: Jinglan Zeng			Approved by: Shunyang
Chen					
Trend:					

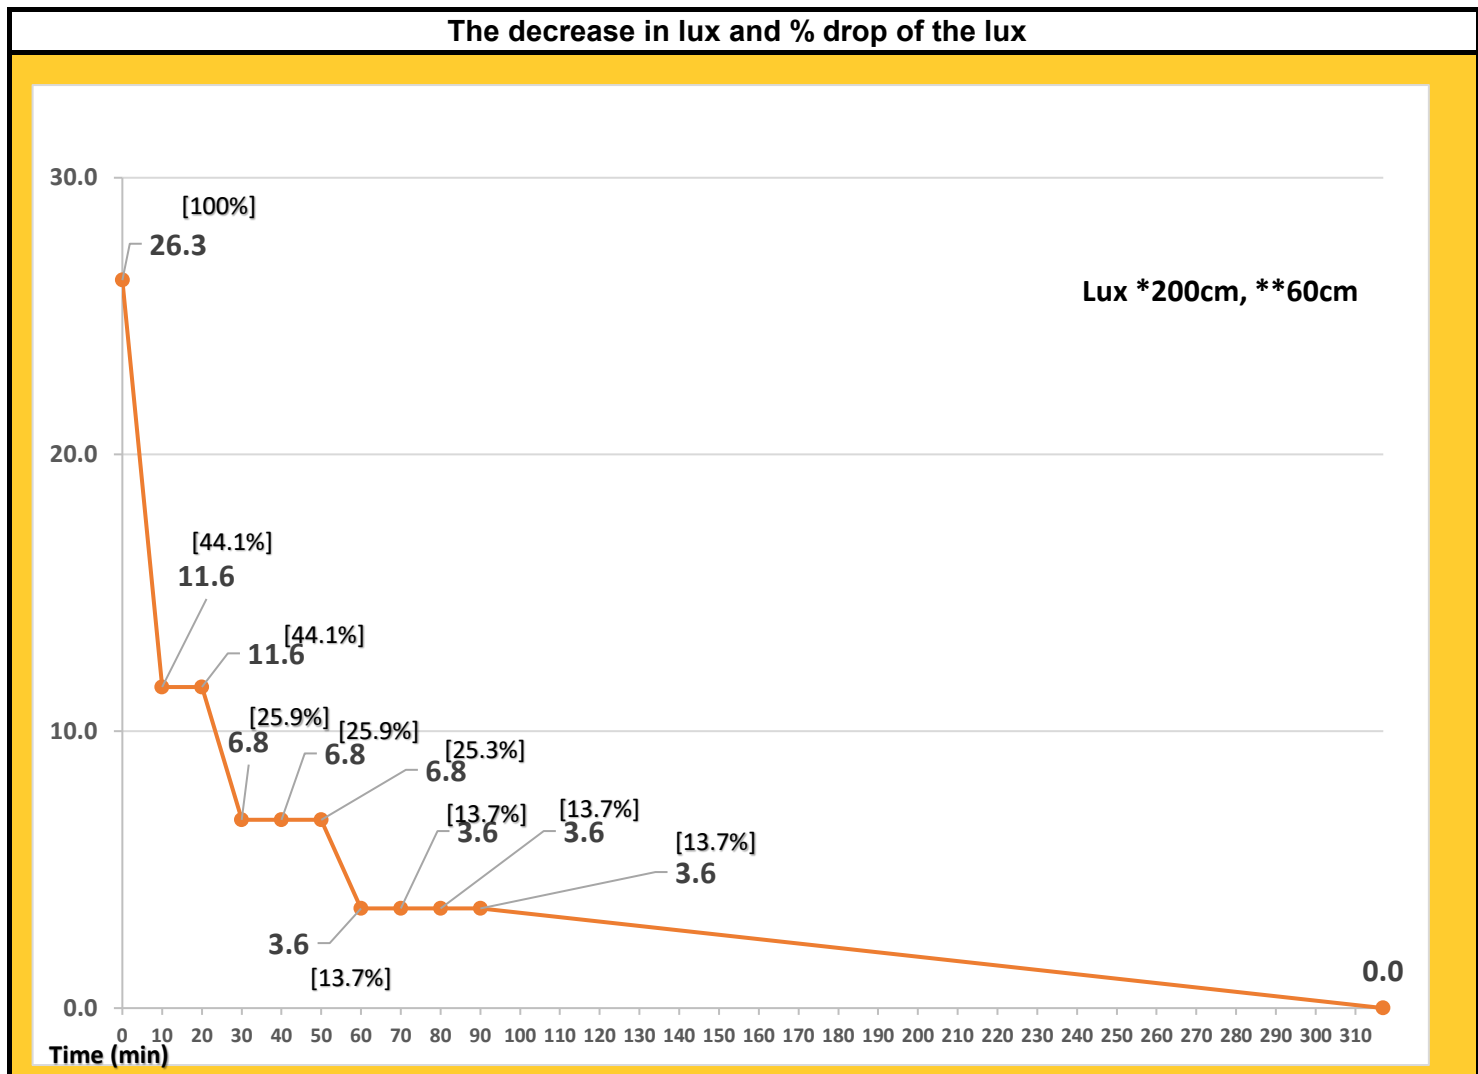

Tester:	Jinglan Zeng			Date:	11/Sep/2023
1	Item number			62/1720/EM	
2	Power source			3pcs IFR18650 2000mAh 3.2V	
3	Input frequency			NA	
4	Power supply properties			Emergency Power Supply	
5	Lux meter			EVERFINE Z-10	
6	Number of samples			1pc	
7	Voltage of full charged batteries without load			11.2V	
				Equipment Model	Illuminance Meter
					EVERFINE Z-10
Time(min)	5000K Lux *200cm, **60cm	% of Lux	***Lux 200cm Center		Remark
Battery ON	26.5				Charge for 24 H, the green light is on, 100% complete charge, collect the luminance value corresponding to the color temperature at different points in time. *Light cone height 200cm **Radius of the base of the light cone 30cm ***Center of the base of the light cone
0	26.5	100.0%	90.3		
15	11.7	44.2%	41.2		
20	11.7	44.2%	41.1		
30	6.9	26.0%	24.2		
40	6.9	26.0%	24.1		
50	6.9	26.0%	24.1		
60	3.6	13.6%	12.7		
70	3.6	13.6%	12.7		
80	3.6	13.6%	12.7		
90	3.6	13.6%	12.7		
317	0.0	0.0%	0.0		
317	Light off				
Tester: Jinglan Zeng Chen		Auditor: Jinglan Zeng			
Trend:					

