

Tester:	Jinglan Zeng			Date:	11/Sep/2023
1	Item number			62/1724/EM	
2	Power source			3pcs IFR18650 2000mAh 3.2V	
3	Input frequency			NA	
4	Power supply properties			Emergency Power Supply	
5	Lux meter			EVERFINE Z-10	
6	Number of samples			1pc	
7	Voltage of full charged batteries without load			11.2V	
				Equipment Model	Illuminance Meter
	2700K	% of Lux	***Lux 200cm Center		EVERFINE Z-10
Time(min)	Lux *200cm, **60cm			Remark	
Battery ON	28.6				Charge for 24 H, the green light is on, 100% complete charge, collect the luminance value corresponding to the color temperature at different points in time. *Light cone height 200cm **Radius of the base of the light cone 30cm ***Center of the base of the light cone
0	26.1	100.0%	100.5		
10	14.1	54.0%	49.6		
20	14.1	54.0%	49.4		
30	8.7	33.3%	30.6		
40	8.7	33.3%	30.6		
50	8.7	33.3%	30.6		
60	5.1	19.5%	18.0		
70	5.1	19.5%	18.0		
80	5.1	19.5%	18.0		
90	5.1	19.5%	18.0		
249	0.0	0.0%	0.0		
249	Light off				
Tester:	Jinglan Zeng	Auditor: Jinglan Zeng		Approved by: Shunyang Chen	


Tester: Jinglan Zeng
Chen

Auditor: Jinglan Zeng

Approved by: Shunyang

Trend:

The decrease in lux and % drop of the lux

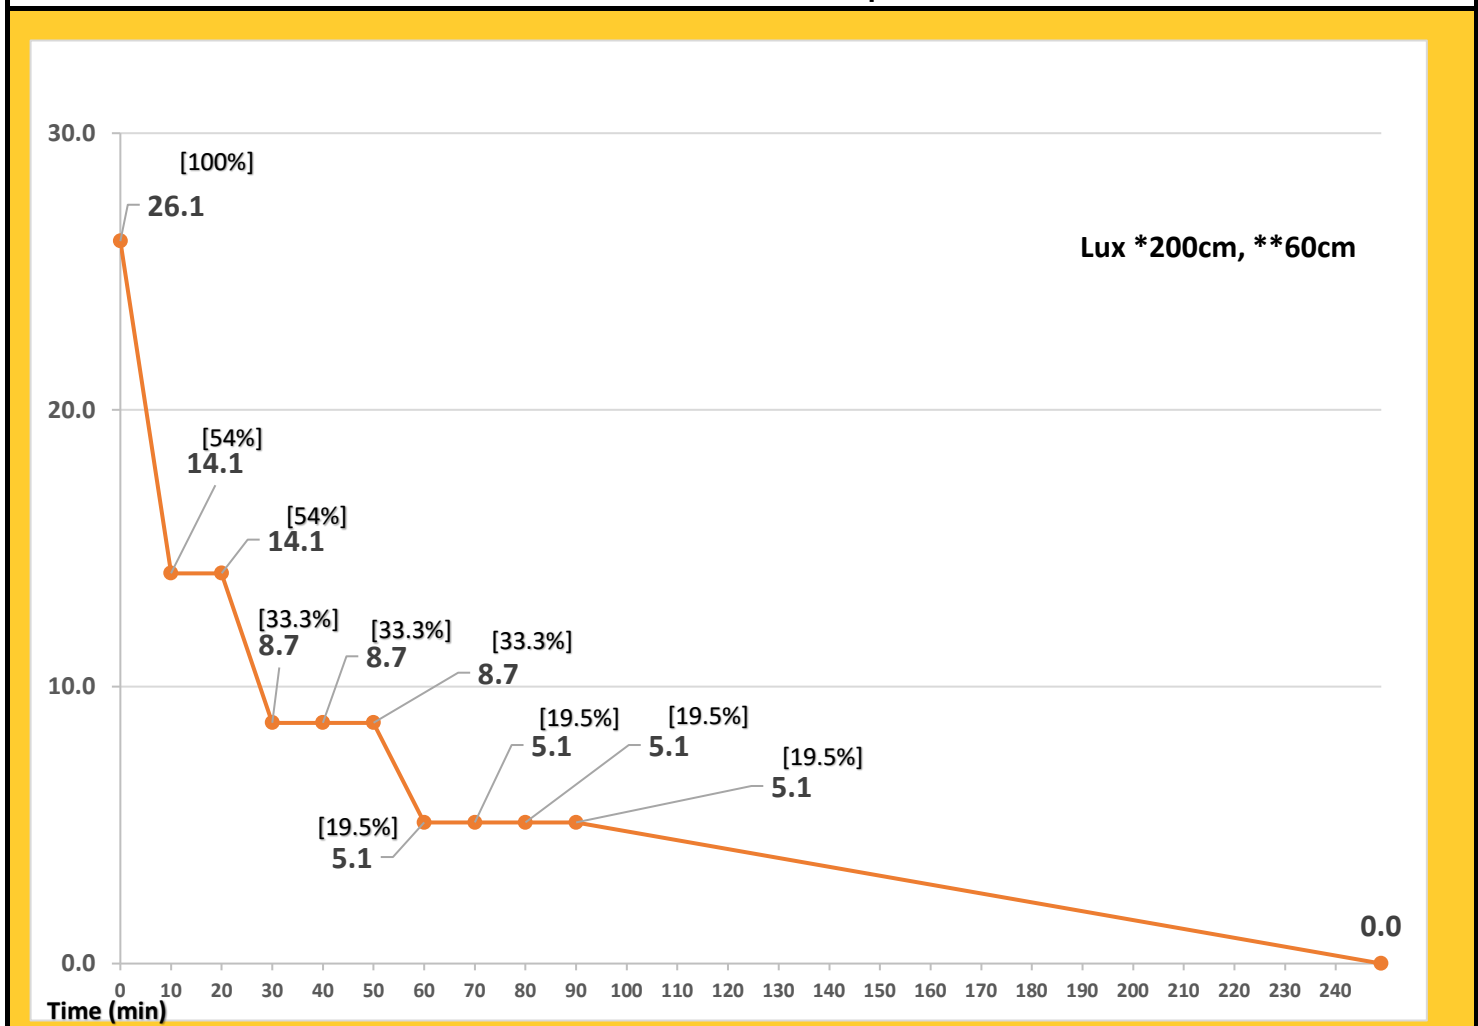

Tester:	Jinglan Zeng			Date:	11/Sep/2023
1	Item number			62/1724/EM	
2	Power source			3pcs IFR18650 2000mAh 3.2V	
3	Input frequency			NA	
4	Power supply properties			Emergency Power Supply	
5	Lux meter			EVERFINE Z-10	
6	Number of samples			1pc	
7	Voltage of full charged batteries without load			11.2V	
				Equipment Model	Illuminance Meter
					EVERFINE Z-10
Time(min)	3000K Lux *200cm, **60cm	% of Lux	***Lux 200cm Center		Remark
Battery ON	28.9				Charge for 24 H, the green light is on, 100% complete charge, collect the luminance value corresponding to the color temperature at different points in time. *Light cone height 200cm **Radius of the base of the light cone 30cm ***Center of the base of the light cone
0	28.9	100.0%	101.5		
10	14.3	49.5%	50.0		
20	14.3	49.5%	50.0		
30	8.8	30.4%	31.0		
40	8.8	30.4%	31.0		
50	8.8	30.4%	31.0		
60	5.2	18.0%	18.3		
70	5.2	18.0%	18.3		
80	5.2	18.0%	18.3		
90	5.2	18.0%	18.3		
249	0.0	0.0%	0.0		
249	Light off				


Tester: Jinglan Zeng
Chen

Auditor: Jinglan Zeng


Approved by: Shunyang

Trend:


The decrease in lux and % drop of the lux

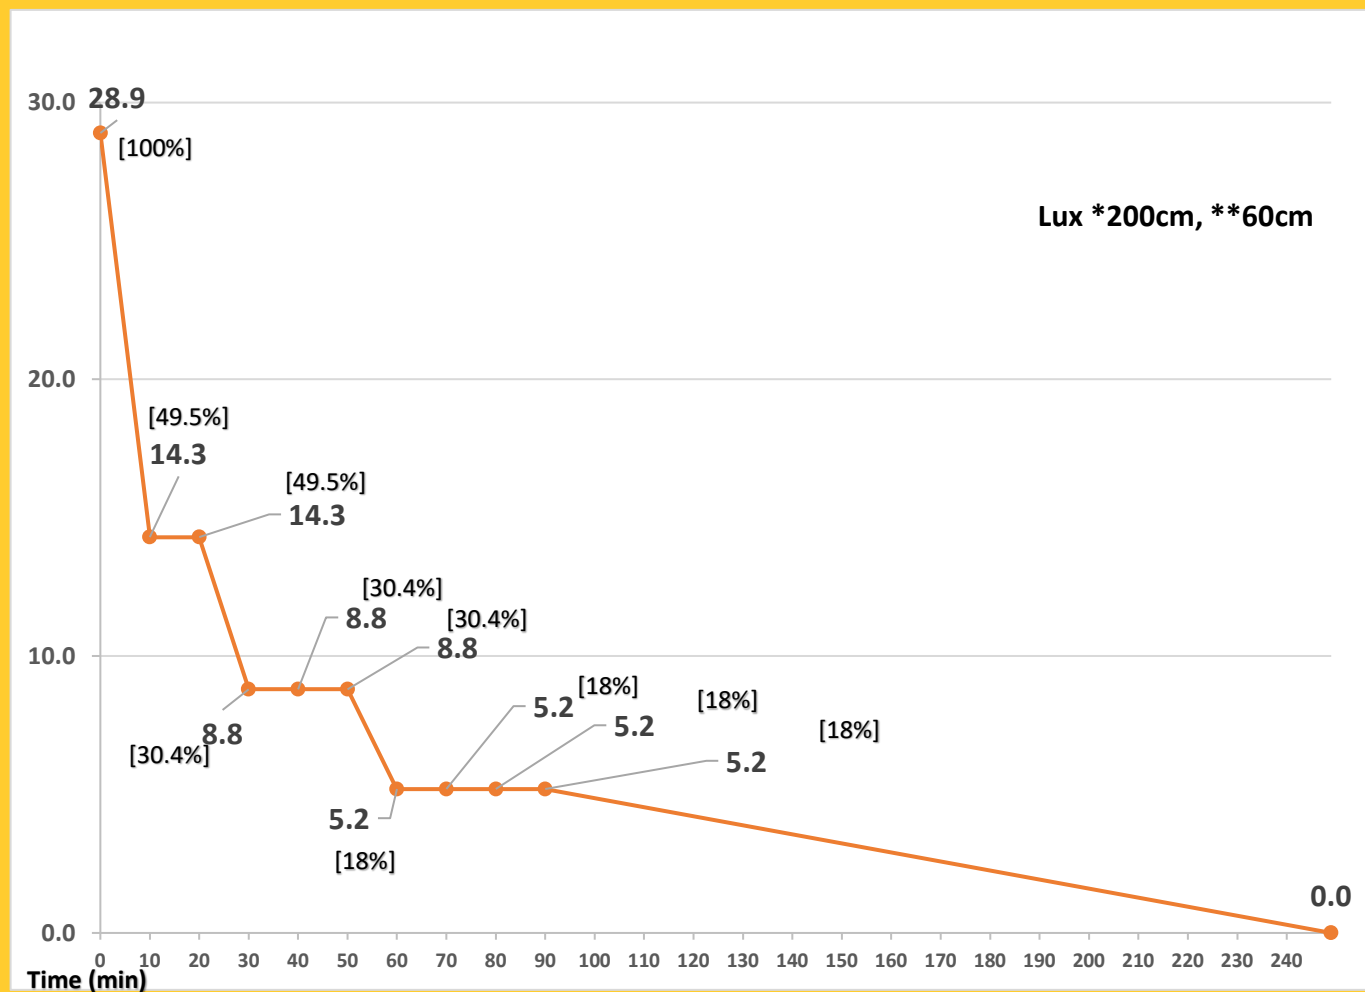

Tester:	Jinglan Zeng			Date:	11/Sep/2023
1	Item number			62/1724/EM	
2	Power source			3pcs IFR18650 2000mAh 3.2V	
3	Input frequency			NA	
4	Power supply properties			Emergency Power Supply	
5	Lux meter			EVERFINE Z-10	
6	Number of samples			1pc	
7	Voltage of full charged batteries without load			11.2V	
				Equipment Model	Illuminance Meter
	3500K	% of Lux	***Lux 200cm Center		EVERFINE Z-10
Time(min)	Lux *200cm, **60cm				
Battery ON	29.4				Charge for 24 H, the green light is on, 100% complete charge, collect the luminance value corresponding to the color temperature at different points in time. *Light cone height 200cm **Radius of the base of the light cone 30cm ***Center of the base of the light cone
0	29.4	100.0%	103.3		
10	14.4	49.0%	50.6		
20	14.4	49.0%	50.6		
30	8.9	30.3%	31.3		
40	8.9	30.3%	31.3		
50	8.9	30.3%	31.3		
60	5.3	18.0%	18.6		
70	5.3	18.0%	18.6		
80	5.3	18.0%	18.6		
90	5.3	18.0%	18.6		
249	0.0	0.0%	0.0		
249	Light off				
Tester: Jinglan Zeng					

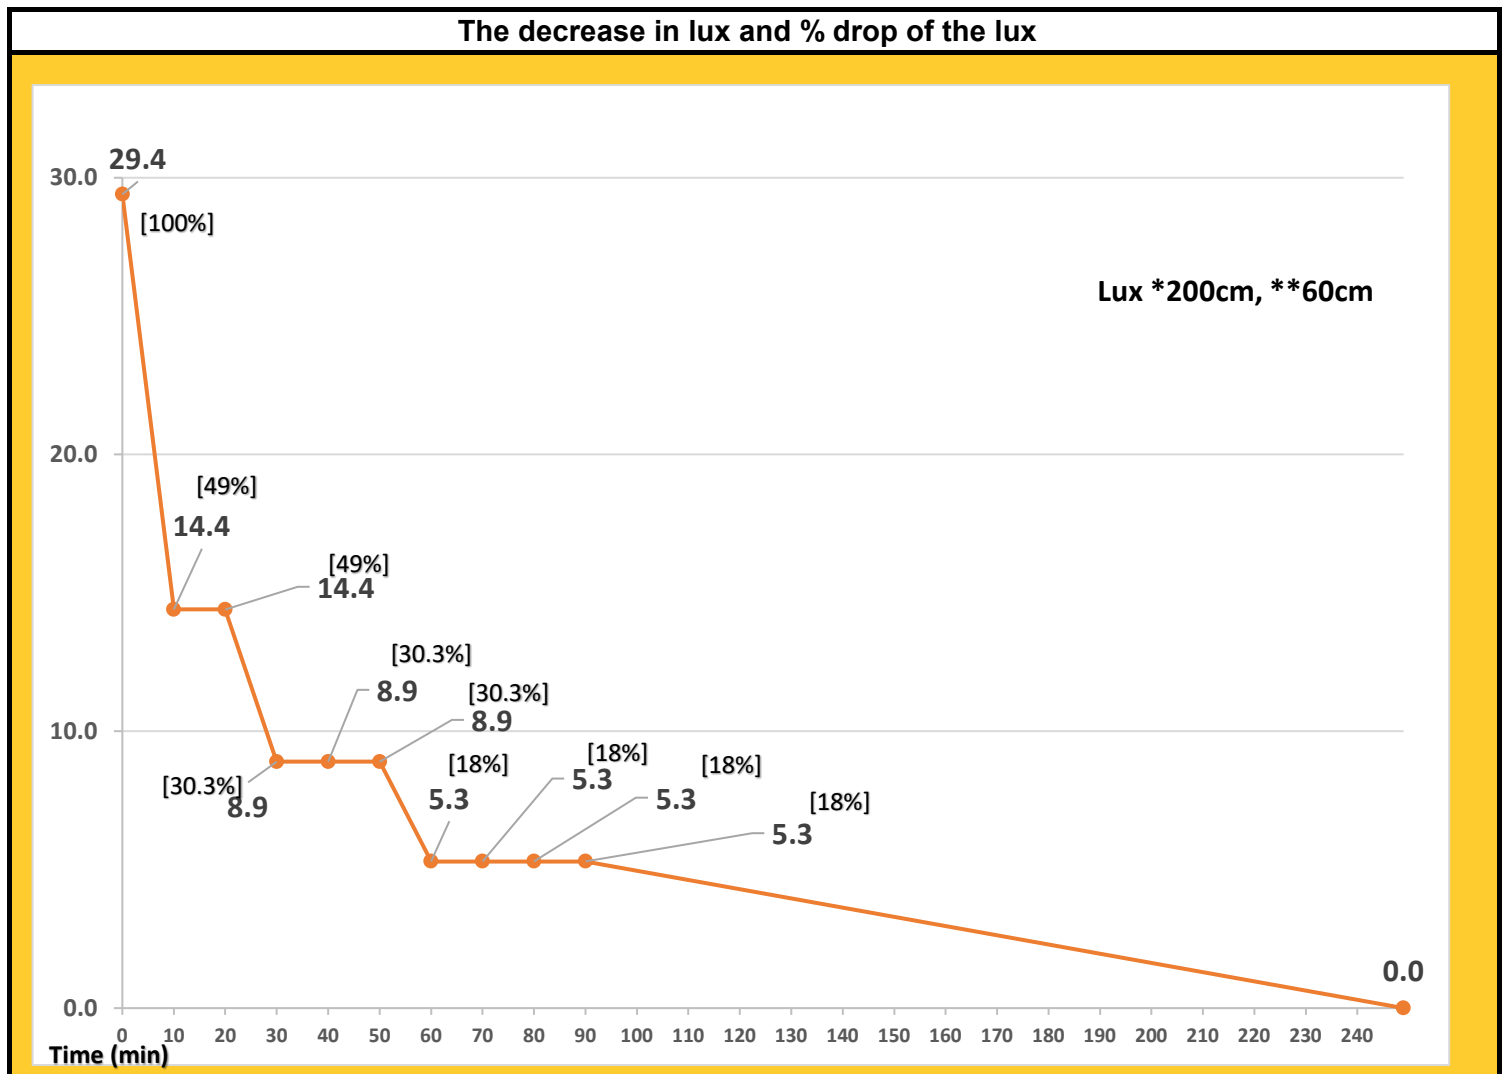

Tester:	Jinglan Zeng			Date:	11/Sep/2023
1	Item number			62/1724/EM	
2	Power source			3pcs IFR18650 2000mAh 3.2V	
3	Input frequency			NA	
4	Power supply properties			Emergency Power Supply	
5	Lux meter			EVERFINE Z-10	
6	Number of samples			1pc	
7	Voltage of full charged batteries without load			11.2V	
				Equipment Model	Illuminance Meter
					EVERFINE Z-10
Time(min)	4000K Lux *200cm, **60cm	% of Lux	***Lux 200cm Center		Remark
Battery ON	29.4				Charge for 24 H, the green light is on, 100% complete charge, collect the luminance value corresponding to the color temperature at different points in time. *Light cone height 200cm **Radius of the base of the light cone 30cm ***Center of the base of the light cone
0	29.4	100.0%	103.2		
10	14.5	49.3%	51.0		
20	14.5	49.3%	51.0		
30	9.0	30.6%	32.0		
40	9.0	30.6%	31.6		
50	9.0	30.6%	31.6		
60	5.3	18.0%	18.7		
70	5.3	18.0%	18.7		
80	5.3	18.0%	18.7		
90	5.3	18.0%	18.7		
249	0.0	0.0%	0.0		
249	Light off				
Tester: Jinglan Zeng Chen		Auditor: Jinglan Zeng			Approved by: Shunyang
Trend:					

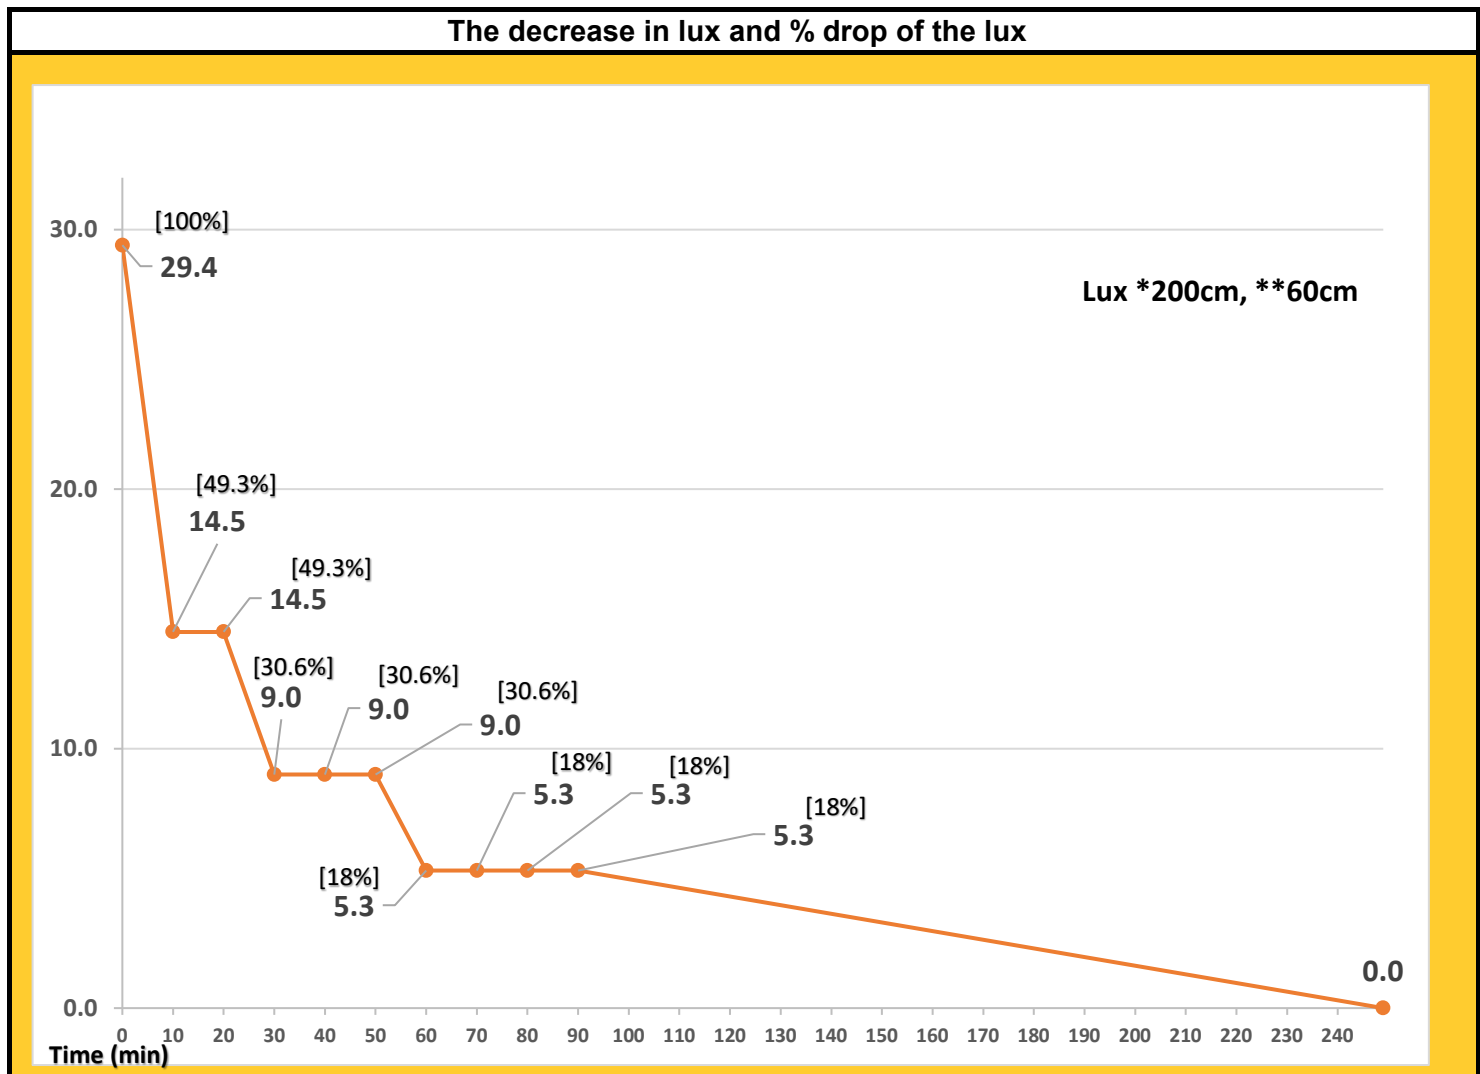

Tester:	Jinglan Zeng			Date:	11/Sep/2023
1	Item number			62/1724/EM	
2	Power source			3pcs IFR18650 2000mAh 3.2V	
3	Input frequency			NA	
4	Power supply properties			Emergency Power Supply	
5	Lux meter			EVERFINE Z-10	
6	Number of samples			1pc	
7	Voltage of full charged batteries without lo			11.2V	
				Equipment Model	Illuminance Meter
	5000K	% of Lux	***Lux 200cm Center		EVERFINE Z-10
Time(min)	Lux *200cm, **60cm				Remark
Battery ON	29.7			Charge for 24 H, the green light is on, 100% complete charge, collect the luminance value corresponding to the color temperature at different points in time. *Light cone height 200cm **Radius of the base of the light cone 30cm ***Center of the base of the light cone	
0	29.7	100.0%	104.1		
10	14.7	49.5%	51.7		
20	14.7	49.5%	51.7		
30	9.1	30.6%	32.0		
40	9.1	30.6%	32.0		
50	9.1	30.6%	32.0		
60	5.4	18.2%	18.9		
70	5.4	18.2%	18.9		
80	5.4	18.2%	18.9		
90	5.4	18.2%	18.9		
249	0.0	0.0%	0.0		
249	Light off				
Tester: Jinglan Zeng		Auditor: Jinglan Zeng		Approved by: Shunyang	
Chen					
Trend:					

